



## MANUAL OF ADMINISTRATION

<b>TOPIC:</b> SUPPORT SERVICES	<b>SUBJECT:</b> Daily Hot Water Check in 24 Hour Support Locations	<b>Code:</b> SS189
		<b>Date of Issue:</b> May 2011
		<b>Revised:</b> September 2019
		<b>Page</b> 1 of 2

**PURPOSE:** To outline the procedure for daily water temperature checks to prevent scalding. The water temperature from a faucet cannot be above 46.0 degrees Celsius.


**EQUIPMENT:** Digital Meat Thermometer (Supplied by Avenue II)  
Container with a handle

**PROCEDURE:**

Every home will have the water temperature checked during the **FIRST scheduled** day shift using the thermometer provided (location of the thermometer is on the posted fire plan) and **prior to any bathing or showering.** When vacationing with support a daily water test must still occur and a thermometer taken with them. If a spare thermometer is needed, please contact the office.

**SUPPORT WORKER RESPONSIBILITIES:**

1. The support worker will run the bathtub hot water faucet for 2 minutes at **full flow** uninterrupted at the hottest setting.
2. The support worker will fill the handled container with hot water and keep the water running into the container throughout the test. While it continues to run into the container test the water temperature by holding the thermometer in the container until the temperature reaches the highest point and stabilizes.
3. If the temperature is 46.0 degrees Celsius or below then the client may bathe or shower.
4. If the temperature is above 46.0 degrees Celsius, the support worker will check the hot water tank to ensure the dial is not set above 115 Fahrenheit or 46.0 degrees Celsius and retest again in one hour. Retesting will occur every hour until 46.0 degrees Celsius or below. Contact Manager / On-Call and complete Incident Report.
5. **Any temperature above 46.0 will prohibit bathing or showering.**

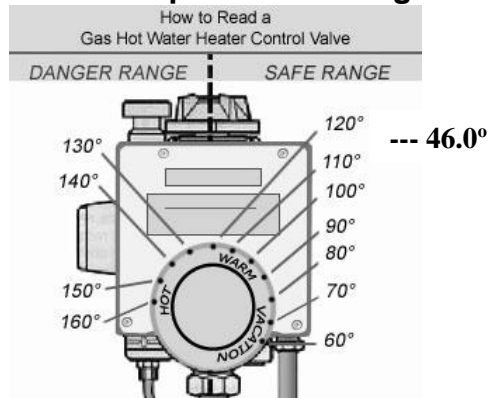

TOTAL INCLUSION THROUGH PEOPLE

*Live, Learn, Succeed*

## MANUAL OF ADMINISTRATION

<b>TOPIC:</b> SUPPORT SERVICES	<b>SUBJECT:</b> Daily Hot Water Check in 24 Hour Support Locations	<b>Code:</b> SS189
		<b>Date of Issue:</b> May 2011
		<b>Revised:</b> September 2019
		<b>Page</b> 2 of 2

6. Should someone not bathe/shower on any given day the support worker will mark N/A in the temp record box, initial below and write the date, reason client did not bathe/shower and staff signature on the back.
7. When vacationing a thermometer must accompany the client in order to test the hot water.
  - 7.1 Should temperature be above 46.0 degrees Celsius alternate options are approved as follows:
    - Mix bath water to ensure temperature does not exceed 46.0 degrees Celsius
    - or
    - Shower water adjusted to not be above 46.0 degrees Celsius. Staff will remain in the bathroom to monitor temperature during shower.Document on an incident report.
8. A manual pool thermometer will also be kept on site and used if the digital thermometer is not working.
9. **Exception:** if bathing is prohibited and the client will experience high anxiety, if it will disrupt their routine, a pre-approved support routine will be developed and approved by Manager/Management for special circumstances. This will be added to the Bathing, Shower Protocol. Use of this protocol will require an incident report.

### **SUPERVISOR RESPONSIBILITIES:**

1. If the temperature is above 46.0 degrees Celsius, the Manager or On-Call Supervisor will direct the support worker to check the water temperature hourly and write an incident report and/or contact landlord to service if required.